


實驗室測試台架規劃

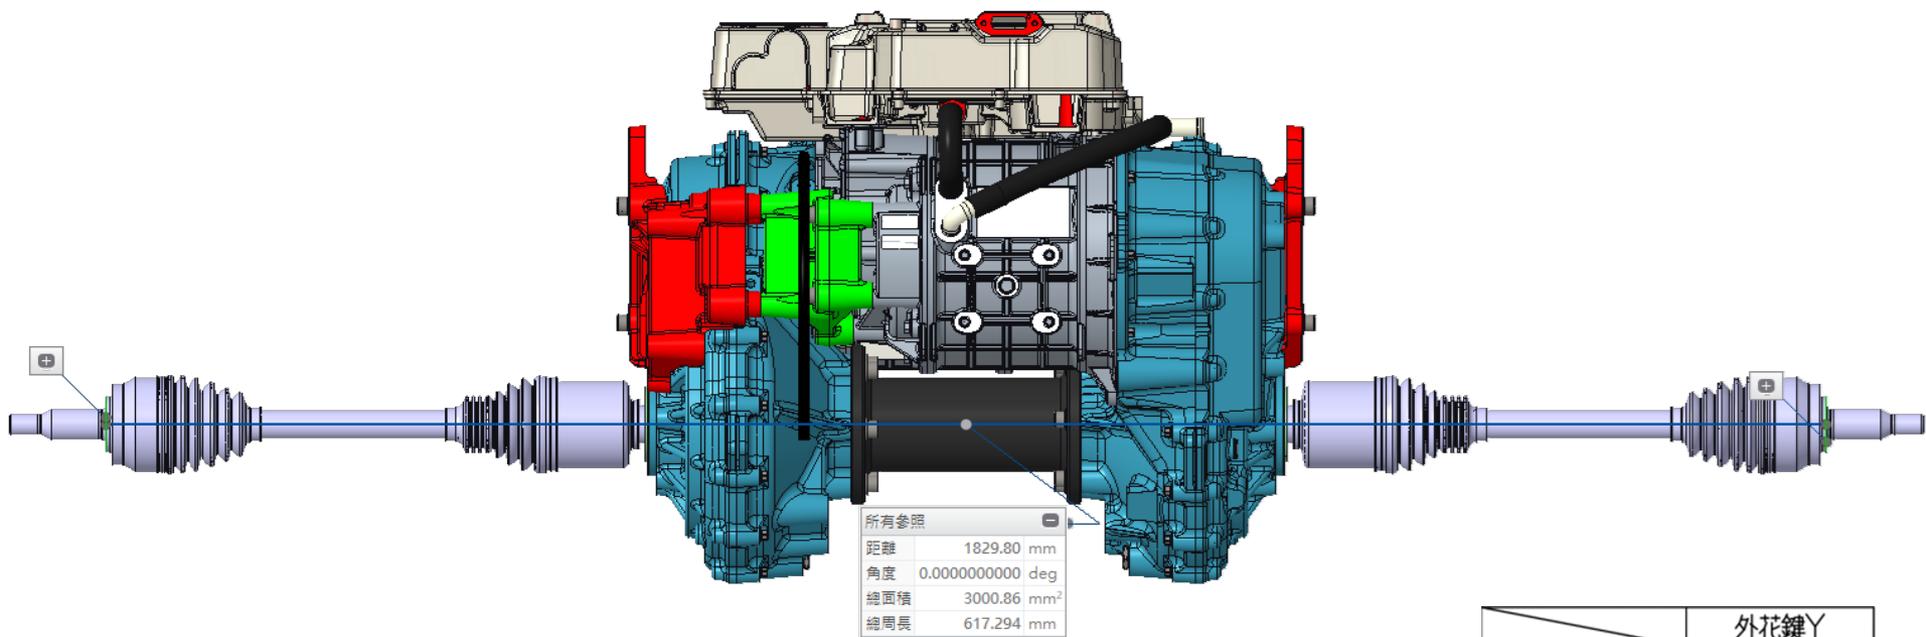

		外花鍵Y
齒數	Z	31
模數	M	24/48
壓力角	α	45°
大徑	Dei	$\phi 33.85_{-0.23}^0$
小徑	Dii	$\phi 31.5_{0}^{+0.23}$
量棒直徑	DRi	$\phi 2.032$
量棒距	MRi	$36.095_{-0.03}^0$